


DATA SHEET							
MODEL	Length			VOLUME		WEIGHT	
	mm	inch	+/-	Liters	CU.Ft	Kg	LBS
10×15	384	15.12	3	14	0.495	2.57	5.65
10×17	434	17.09	4	16.5	0.583	3.04	6.69
10×24	609	23.98	4	24.8	0.88	3.89	8.56
10×26	664	26.14	4	27.33	0.97	4.04	8.98
10×30	765	30.12	4	32.28	1.14	4.69	10.32
10×35	893	35.16	4	38.3	1.35	4.93	10.85
10×40	1022	40.24	4	44.65	1.58	5.64	12.41
10×44	1121	44.13	4	48.8	1.72	6.19	13.62
10×47	1198	47.17	4	53.2	1.88	6.54	14.39
10×54	1381	54.37	5	61	2.16	7.69	16.92

NOTES:

- TANK MUST MEET ALL APPLICABLE SPECIFICATIONS OF NSF/ANSI 044 STANDARD, LATEST REVISION.
- OPERATING SPECIFICATIONS:
 - MAXIMUM WORKING PRESSURE - 150PSI (10.5BAR)
 - TEMPERATURE RANGE - 34-122 °F (1-50 °C)
 - MAXIMUM VACUUM - 5.5"Hg (140mm Hg)
 - MEDIA - WATER
- TEST REQUIREMENT
 - BURST PRESSURE TEST: 4.2MPa
 - CYCLIC PRESSURE TEST: 1.05MPa / 100,000 CYCLES
 - HYDROSTATIC PRESSURE TEST: 2.52MPa / KEEP 15MINs
- VISUAL LINER INSPECTION
 - NO MORE THAN 10 INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS.
 - NO INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS LARGER THAN 3 x 3mm
 - NO INTERNAL BLEMISHES OR BURNT DEBRIS ALLOWED
- ALL GLASS STRANDS FROM FIBERGLASS LINER TO BE BONDED AND COVERED
- LABEL'S POSITION CAN BE CHANGED WITH THE CUSTOMER'S REQUIREMENT

						10" FRP PRESSURE VESSEL WITH BASE	
VERSION NO.	DESCRIPTION OF CHANGES:				SIGNATURE	DATE	
DESIGNER		STANDARD	STAGE	REMARK	NUMBER / SET	SCALE	/
						1:4	MATERIAL:
INSPECTION		AUTHORIZATION	PROJECTION				FRP-PV.10.00
TECHNOLOGIST			TOTAL PAGES:		PAGE NO.		

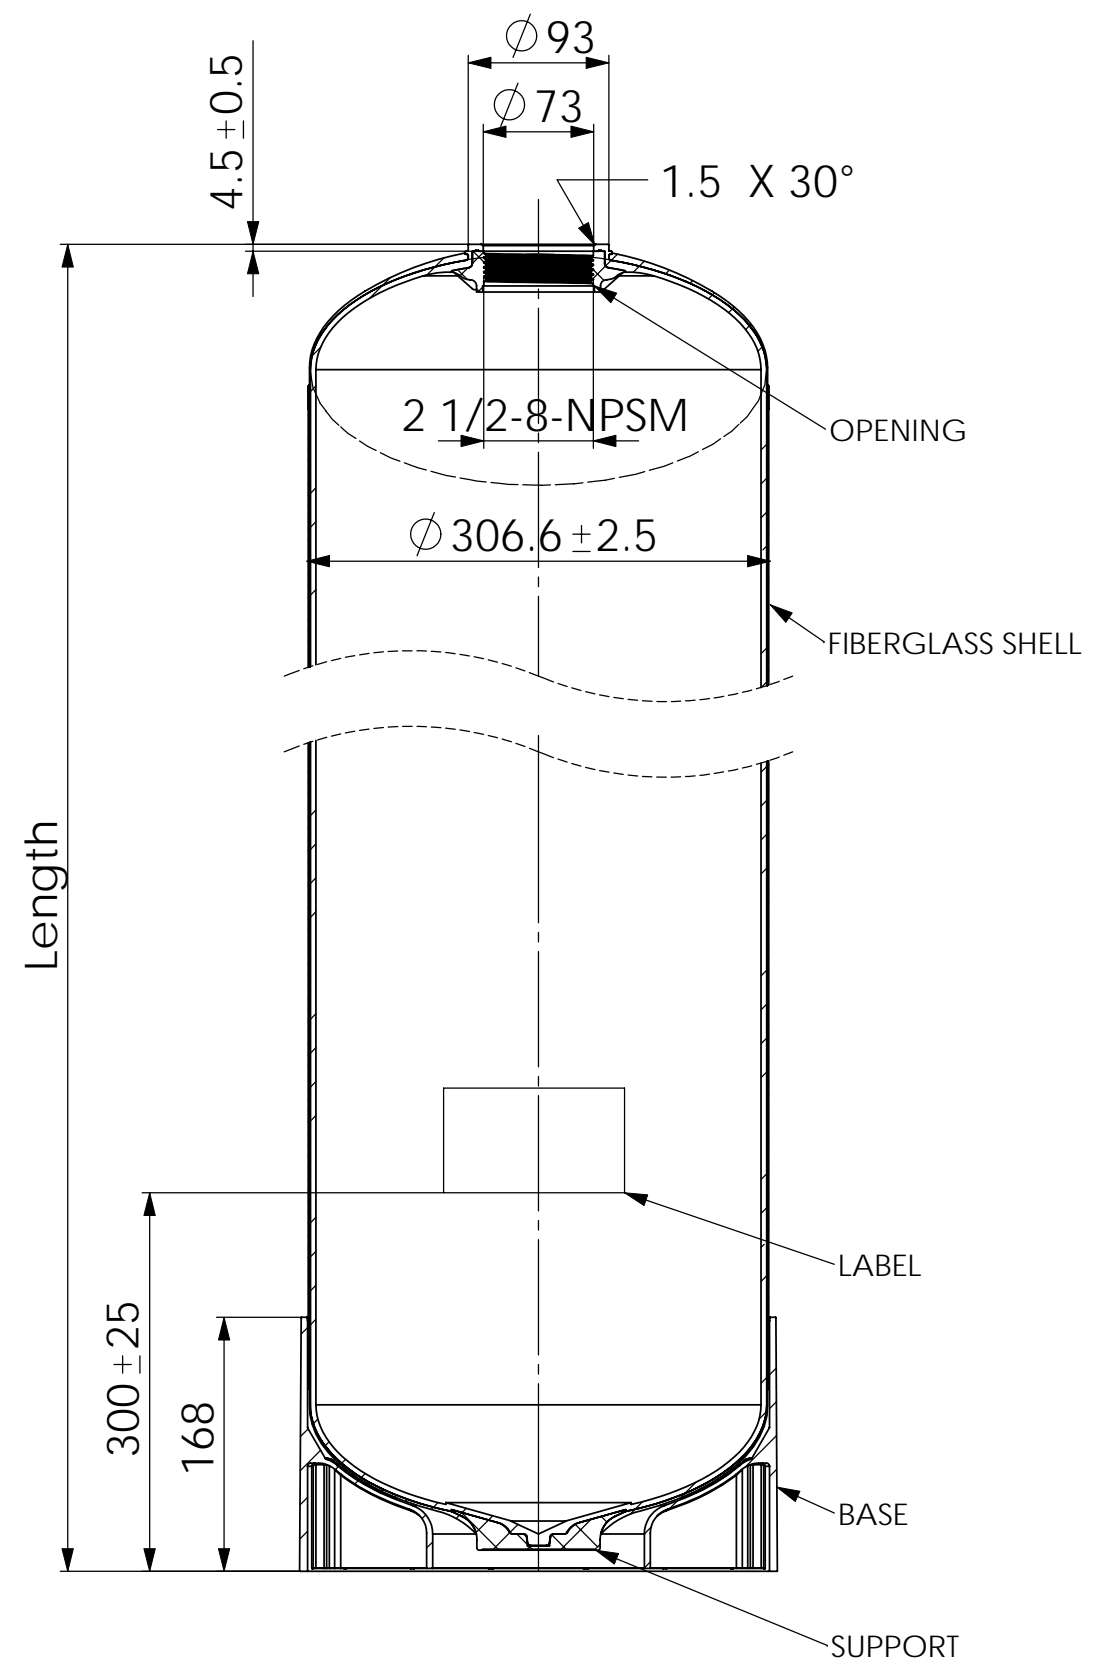


DATA SHEET							
MODEL	Length			VOLUME		WEIGHT	
	mm	inch	+/-	Liters	CU.Ft	Kg	LBS
12x17	448	17.64	4	23.6	0.83	4.04	8.9
12x48	1232	48.5	5	78.54	2.78	8.05	17.71
12x52	1338	52.68	5	84.7	2.99	8.63	18.99

NOTES:

- TANK MUST MEET ALL APPLICABLE SPECIFICATIONS OF NSF/ANSI 044 STANDARD, LATEST REVISION.
- OPERATING SPECIFICATIONS:
 - MAXIMUM WORKING PRESSURE - 150PSI (10.5BAR)
 - TEMPERATURE RANGE - 34-122 °F (1-50 °C)
 - MAXIMUM VACUUM - 5.5"Hg (140mm Hg)
 - MEDIA - WATER
- TEST REQUIREMENT
 - BURST PRESSURE TEST: 4.2MPa
 - CYCLIC PRESSURE TEST: 1.05MPa / 100,000 CYCLES
 - HYDROSTATIC PRESSURE TEST: 2.52MPa / KEEP 15MINS
- VISUAL LINER INSPECTION
 - NO MORE THAN 10 INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS.
 - NO INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS LARGER THAN 3 x 3mm
 - NO INTERNAL BLEMISHES OR BURNT DEBRIS ALLOWED
- ALL GLASS STRANDS FROM FIBERGLASS LINER TO BE BONDED AND COVERED
- LABEL'S POSITION CAN BE CHANGED WITH THE CUSTOMER'S REQUIREMENT

						12" FRP PRESSURE VESSEL WITH BASE	
VERSION NO.	DESCRIPTION OF CHANGES:				SIGNATURE	DATE	/
DESIGNER	STANDARD	STAGE	REMARK	NUMBER /SET	SCALE		
				1	1:5	MATERIAL:	
INSPECTION	AUTHORIZATION	PROJECTION				FRP-PV.12.00	
TECHNOLOGIST		TOTAL PAGES:		PAGE NO.			

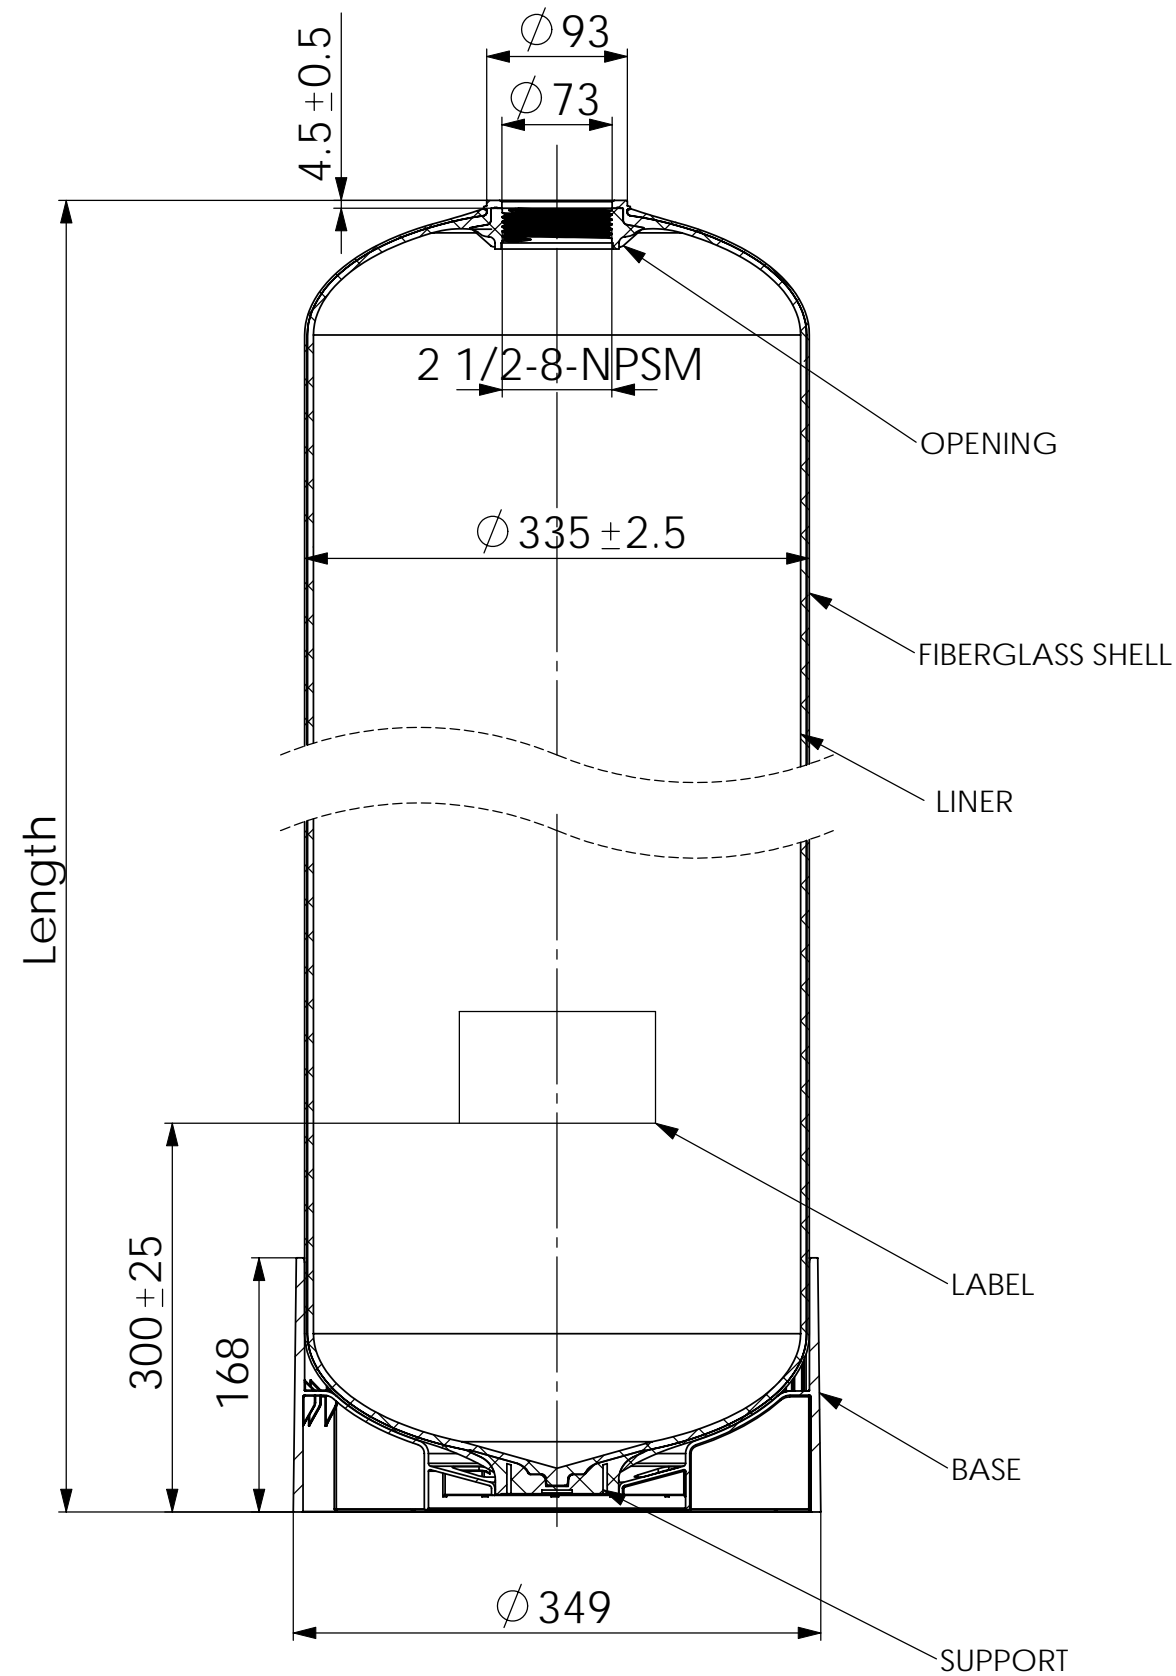

DATA SHEET							
MODEL	Length			VOLUME		WEIGHT	
	mm	inch	+/-	Liters	CU.Ft	Kg	LBS
13×44	1145	45.08	4	84.8	3.0	8.28	18.22
13×54	1398	55.04	5	105.7	3.74	10.6	23.32

NOTES:

- TANK MUST MEET ALL APPLICABLE SPECIFICATIONS OF NSF/ANSI 044 STANDARD, LATEST REVISION.
- OPERATING SPECIFICATIONS:
 - MAXIMUM WORKING PRESSURE - 150PSI (10.5BAR)
 - TEMPERATURE RANGE - 34-122 °F (1-50 °C)
 - MAXIMUM VACUUM - 5.5"Hg (140mm Hg)
 - MEDIA - WATER
- TEST REQUIREMENT
 - BURST PRESSURE TEST: 4.2MPa
 - CYCLIC PRESSURE TEST: 1.05MPa / 100,000 CYCLES
 - HYDROSTATIC PRESSURE TEST: 2.52MPa / KEEP 15MINs
- VISUAL LINER INSPECTION
 - NO MORE THAN 10 INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS.
 - NO INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS LARGER THAN 3 x 3mm
 - NO INTERNAL BLEMISHES OR BURNT DEBRIS ALLOWED
- ALL GLASS STRANDS FROM FIBERGLASS LINER TO BE BONDED AND COVERED
- LABEL'S POSITION CAN BE CHANGED WITH THE CUSTOMER'S REQUIREMENT

						13"-2.5 FRP PRESSURE VESSEL with base	
VERSION NO.	DESCRIPTION OF CHANGES:				SIGNATURE	DATE	
DESIGNER		STANDARD	STAGE	REMARK	NUMBER /SET	SCALE	/
					1	1:5	MATERIAL:
INSPECTION		AUTHORIZATION	PROJECTION				
TECHNOLOGIST			TOTAL PAGES:		PAGE NO.		

FRP-PV.06.00

DATA SHEET

A


B

C

D

E

F

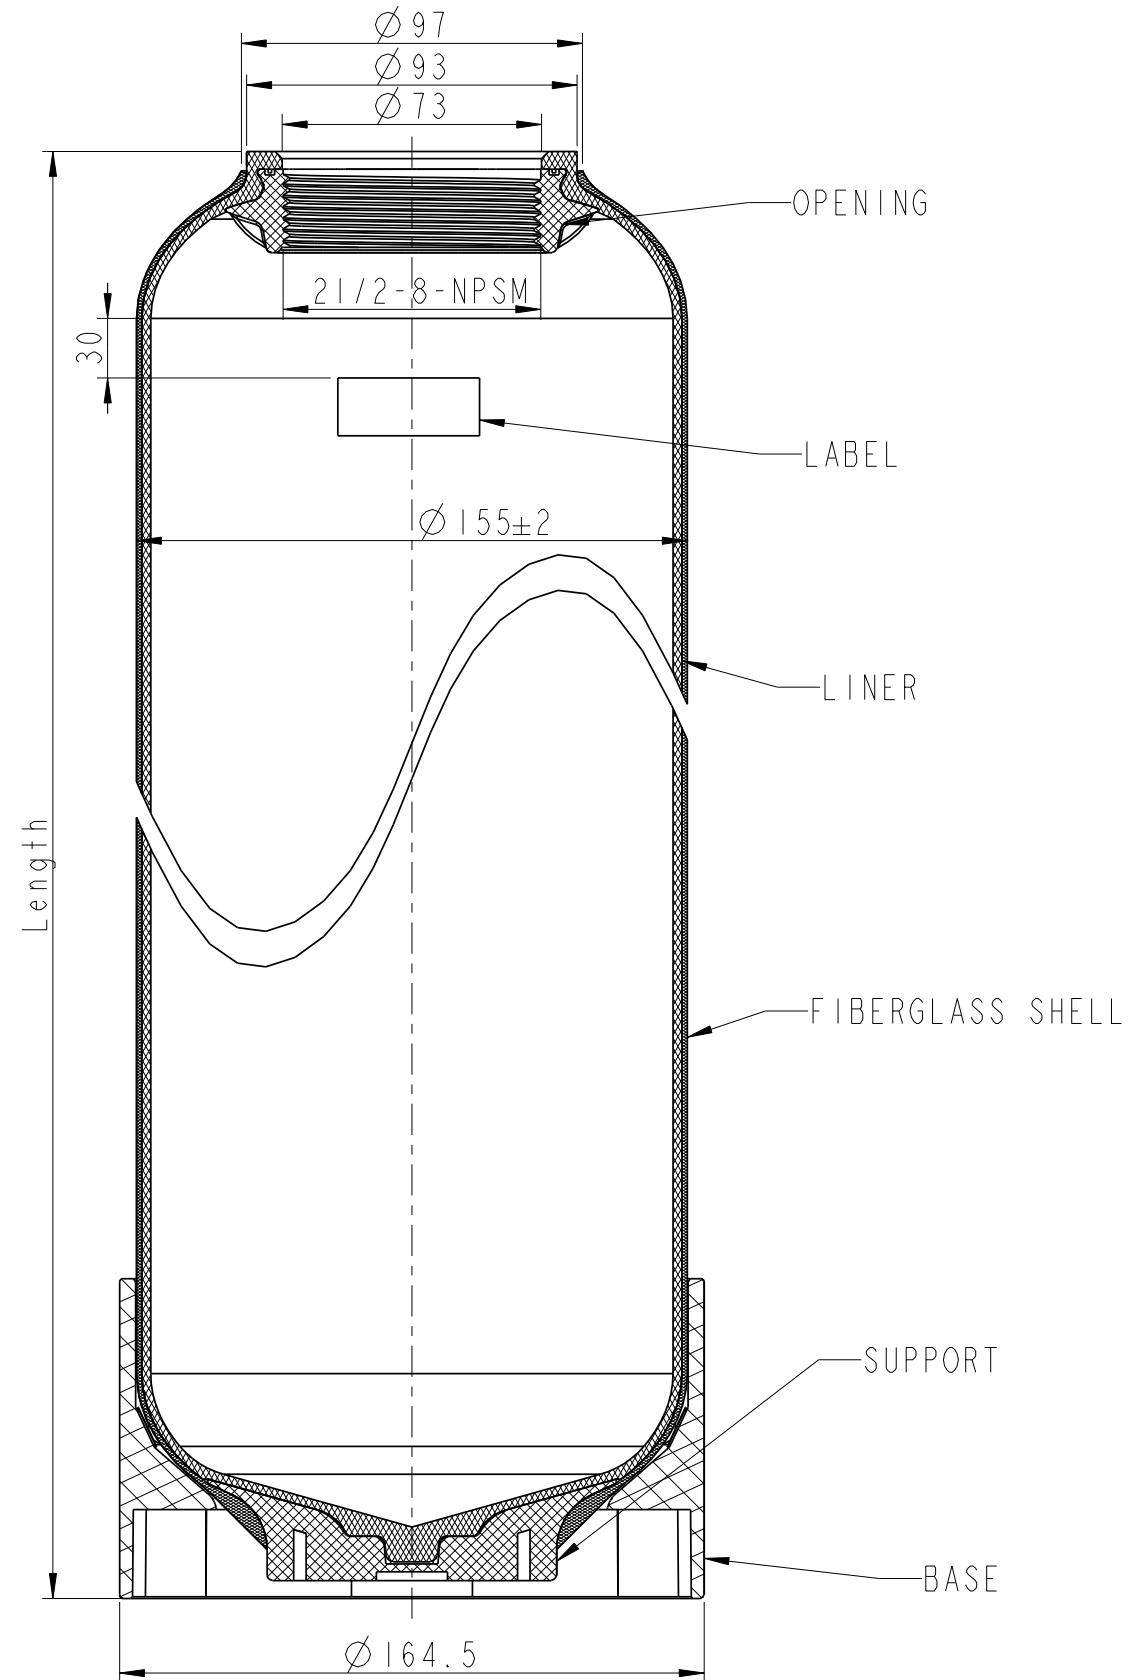


MODEL	Length			VOLUME		WEIGHT	
	mm	inch	+/-	Liters	CU.Ft	Kg	LBS
06X13	336	13.22	±3	4.6	0.16	1.3	2.87
06X17	437	17.2	±3	6.3	0.22	1.57	3.46
06X18	463	18.22	±3	6.8	0.24	1.7	3.75
06X22	567	22.32	±3	8.5	0.3	2.1	4.63
06X35	896	35.28	±4	14.1	0.5	2.96	6.53

Notes:

- Tank must meet all applicable specifications of NSF/ANSI 044 standard , latest revision.
- Operating specifications:
 - A. Maximum working pressure - 150PSI(10.5bar).
 - B. Temperature range - 34-122 F(1-50 C).
 - C. Maximum vacuum - 5.5"Hg(140mmHg).
 - D. Media - water.
- Test requirment
 - A. Burst pressure test:4.2MPa.
 - B. Cyclic pressure test:1.05MPa/100,000 cycles.
 - C. Hydrostatic pressure test:2.52MPa/keep 15mins
- Visual liner inspection
 - A. No more than 10 internal or external blemishes or burnt debris.
 - B. No internal or external blemishes or burnt debris larger than 3*3mm.
 - C. No internal blemishes or burnt debris all owed
- All glass strands from fiberglass liner to be bonded and covered.
- Label's position can be changed with the cunstomer's requirement.

				CANATURE GROUP			
				06" FRP PRESSURE VESSEL			
VERSION NO	DESCRIPTION OF CHANGES			SIGNA TURE	DATE		
DESIGNER	STANDARD		STAGE REMARK	NUMBER /SET	SCALE		
			S		1:2		
INSPECTION	AUTHORIZATION			PROJECTION	SOURCING FROM		
TECHNOLOGIST				TOTAL PAGES:1 PAGE NO: 1		FRP-PV.06.00	

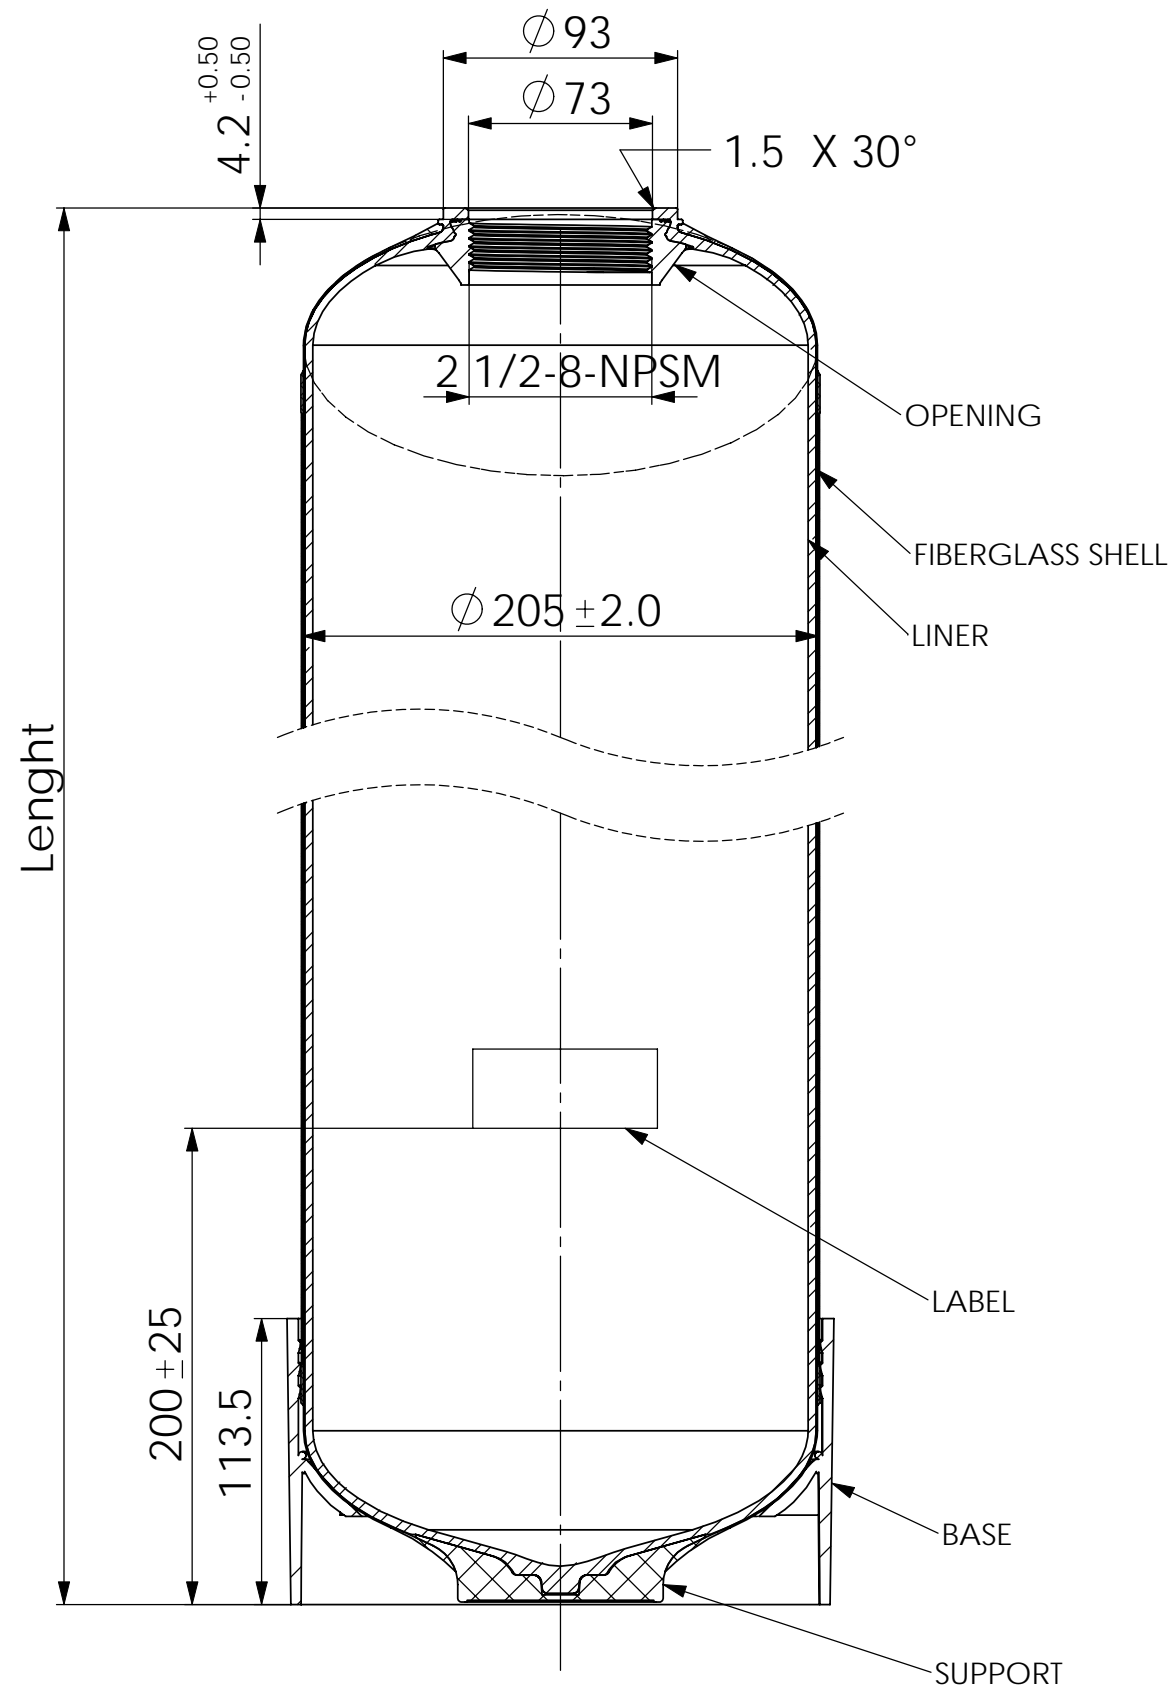

DATA SHEET							
MODEL	Length			VOLUME		WEIGHT	
	mm	inch	+/-	Liters	CU.Ft	Kg	LBS
08×15	385	15.16	3	9.3	0.33	1.83	4.03
08×17	437	17.2	4	10.5	0.37	2.3	5.06
08×18	462	18.19	4	11.5	0.41	2.55	5.61
08×24	615	24.01	4	16.6	0.59	2.94	6.47
08×26	665	26.18	4	18.1	0.64	3.15	6.93
08×30	770	30.31	4	21	0.74	3.65	8.03
08×35	897	35.3	4	23.6	0.83	4.05	8.91
08×44	1122	44.17	4	31.3	1.11	4.45	9.79

NOTES:

- TANK MUST MEET ALL APPLICABLE SPECIFICATIONS OF NSF/ANSI 044 STANDARD, LATEST REVISION.
- OPERATING SPECIFICATIONS:
 - MAXIMUM WORKING PRESSURE - 150PSI (10.5BAR)
 - TEMPERATURE RANGE - 34-122 °F (1-50 °C)
 - MAXIMUM VACUUM - 5.5"Hg (140mm Hg)
 - MEDIA - WATER
- TEST REQUIREMENT
 - BURST PRESSURE TEST: 4.2MPa
 - CYCLIC PRESSURE TEST: 1.05MPa / 100,000 CYCLES
 - HYDROSTATIC PRESSURE TEST: 2.52MPa / KEEP 15MINs
- VISUAL LINER INSPECTION
 - NO MORE THAN 10 INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS.
 - NO INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS LARGER THAN 3 x 3mm
 - NO INTERNAL BLEMISHES OR BURNT DEBRIS ALLOWED
- ALL GLASS STRANDS FROM FIBERGLASS LINER TO BE BONDED AND COVERED
- LABEL'S POSITION CAN BE CHANGED WITH THE CUSTOMER'S REQUIREMENT

						08" FRP PRESSURE VESSEL With Base	
VERSION NO.	DESCRIPTION OF CHANGES:				SIGNATURE	DATE	
DESIGNER		STANDARD	STAGE	REMARK	NUMBER / SET	SCALE	/
					1	1:3	MATERIAL:
INSPECTION		AUTHORIZATION	PROJECTION				FRP-PV.08.00
TECHNOLOGIST			TOTAL PAGES:	PAGE NO.			