


MODEL	Length			VOLUME		WEIGHT	
	mm	inch	+/-	Liters	CU.Ft	Kg	LBS
14x52	1344	52.91	4	115	4.06	10.9	23.98
14x65	1674	65.91	5	148	5.23	14.8	32.56

NOTES:

- TANK MUST MEET ALL APPLICABLE SPECIFICATIONS OF NSF/ANSI 044 STANDARD, LATEST REVISION.
- OPERATING SPECIFICATIONS:
 - MAXIMUM WORKING PRESSURE - 150PSI (10.5BAR)
 - TEMPERATURE RANGE - 34-122 °F (1-50 °C)
 - MAXIMUM VACUUM - 5.5"Hg (140mm Hg)
 - MEDIA - WATER
- TEST REQUIREMENT
 - BURST PRESSURE TEST: 4.2MPa
 - CYCLIC PRESSURE TEST: 1.05MPa / 100,000 CYCLES
 - HYDROSTATIC PRESSURE TEST: 2.52MPa / KEEP 15MINS
- VISUAL LINER INSPECTION
 - NO MORE THAN 10 INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS.
 - NO INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS LARGER THAN 3 x 3mm
 - NO INTERNAL BLEMISHES OR BURNT DEBRIS ALLOWED
- ALL GLASS STRANDS FROM FIBERGLASS LINER TO BE BONDED AND COVERED
- LABEL'S POSITION CAN BE CHANGED WITH THE CUSTOMER'S REQUIREMENT

						14" FRP PRESSURE VESSEL (4"-8-UN Opening) With Base	
VERSION NO.	DESCRIPTION OF CHANGES:				SIGNATURE	DATE	
DESIGNER		STANDARD	STAGE	REMARK	NUMBER / SET	SCALE	/
						1:5	MATERIAL:
INSPECTION		AUTHORIZATION	PROJECTION				SOURCING FROM:
TECHNOLOGIST				TOTAL PAGES:	PAGE NO.	FRP-PV.14-4".00	

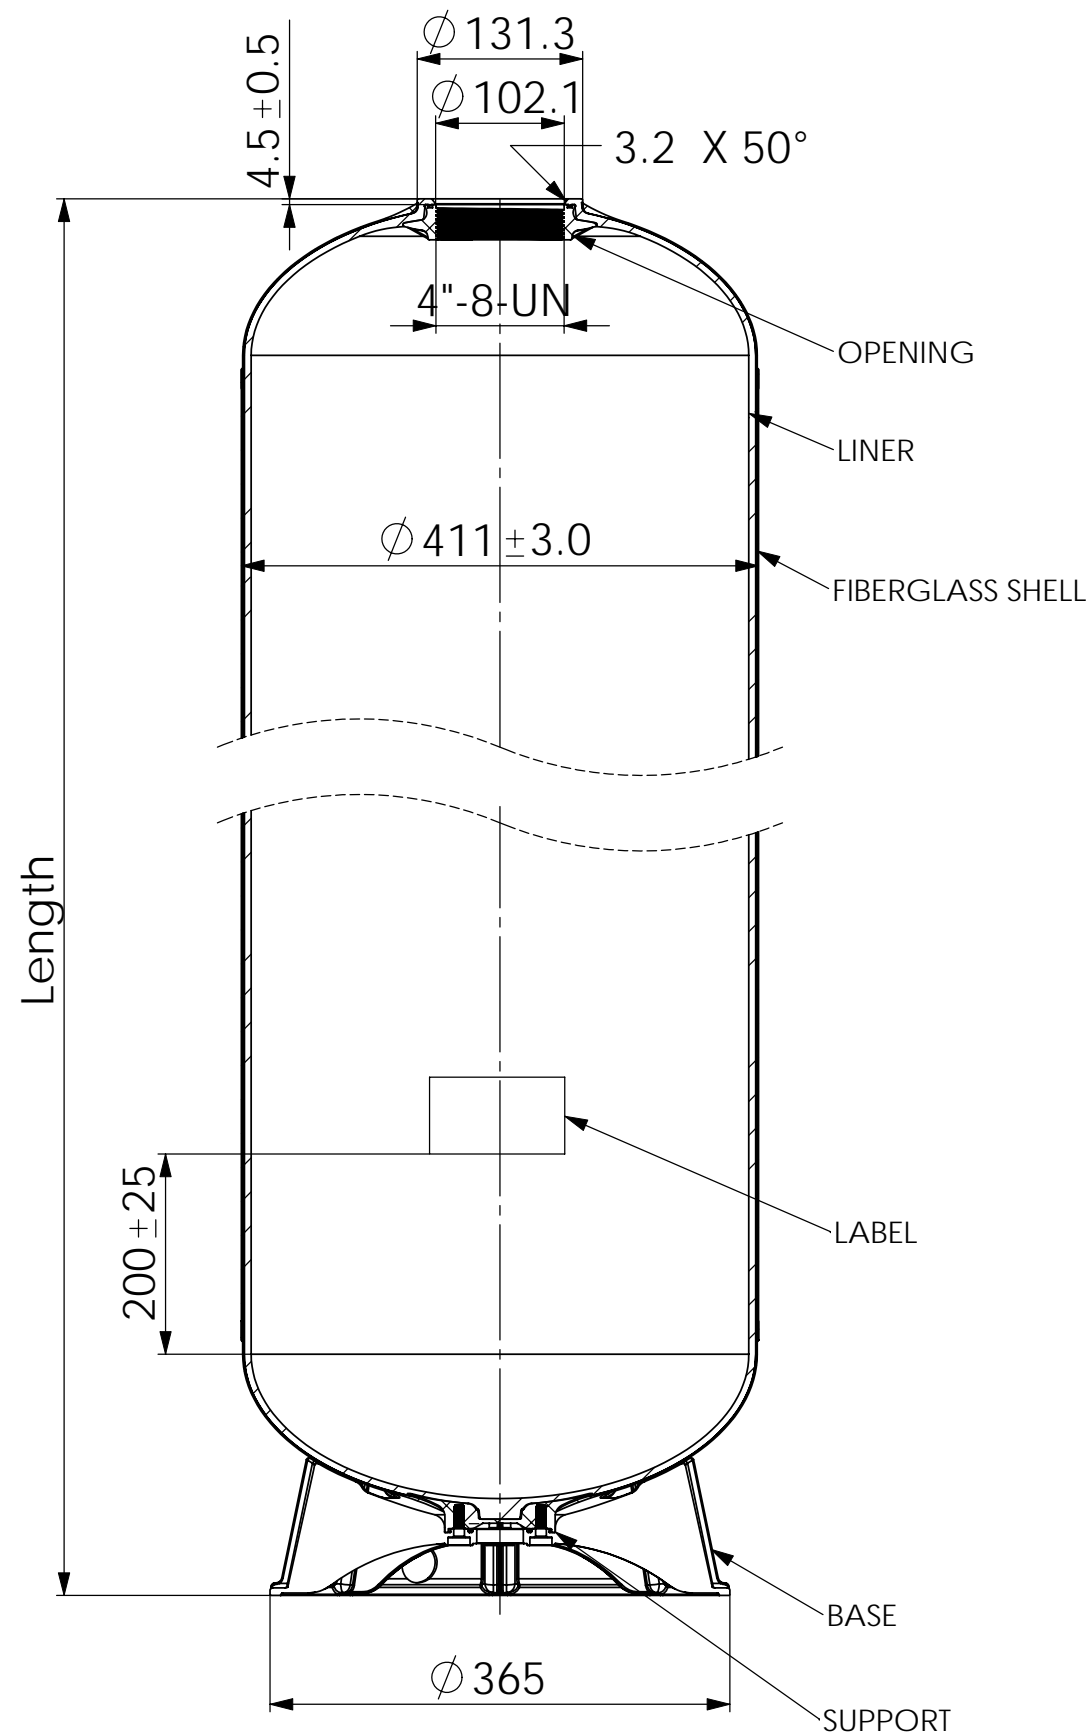


MODEL	Length			VOLUME		WEIGHT	
	mm	inch	+/-	Liters	CU.Ft	Kg	LBS
16×24	624	24.57	3	57	2	6.67	14.67
16×36	968	38.11	4	98.1	3.47	11.32	24.9
16×44	1240	48.82	5	131.6	4.65	13.5	29.7
16×52	1377	54.21	5	148.3	5.24	16.42	36.12
16×65	1706	67.16	6	188.6	6.66	19.47	42.83

NOTES:

- TANK MUST MEET ALL APPLICABLE SPECIFICATIONS OF NSF/ANSI 044 STANDARD, LATEST REVISION.
- OPERATING SPECIFICATIONS:
 - MAXIMUM WORKING PRESSURE - 150PSI (10.5BAR)
 - TEMPERATURE RANGE - 34-122 °F (1-50 °C)
 - MAXIMUM VACUUM - 5.5"Hg (140mm Hg)
 - MEDIA - WATER
- TEST REQUIREMENT
 - BURST PRESSURE TEST: 4.2MPa
 - CYCLIC PRESSURE TEST: 1.05MPa / 100,000 CYCLES
 - HYDROSTATIC PRESSURE TEST: 2.52MPa / KEEP 15MINs
- VISUAL LINER INSPECTION
 - NO MORE THAN 10 INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS.
 - NO INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS LARGER THAN 3 x 3mm
 - NO INTERNAL BLEMISHES OR BURNT DEBRIS ALLOWED
- ALL GLASS STRANDS FROM FIBERGLASS LINER TO BE BONDED AND COVERED
- LABEL'S POSITION CAN BE CHANGED WITH THE CUSTOMER'S REQUIREMENT

						開能 CANATURE GROUP <i>Canature</i>	
						16" FRP PRESSURE VESSEL (4"-8-UN Opening) with base	
VERSION NO.	DESCRIPTION OF CHANGES:				SIGNATURE	DATE	
DESIGNER		STANDARD	STAGE	REMARK	NUMBER / SET	SCALE	/
						1:6	MATERIAL:
INSPECTION		AUTHORIZATION	PROJECTION				SOURCING FROM:
TECHNOLOGIST			TOTAL PAGES:	PAGE NO.		FRP-PV.16-4".00	

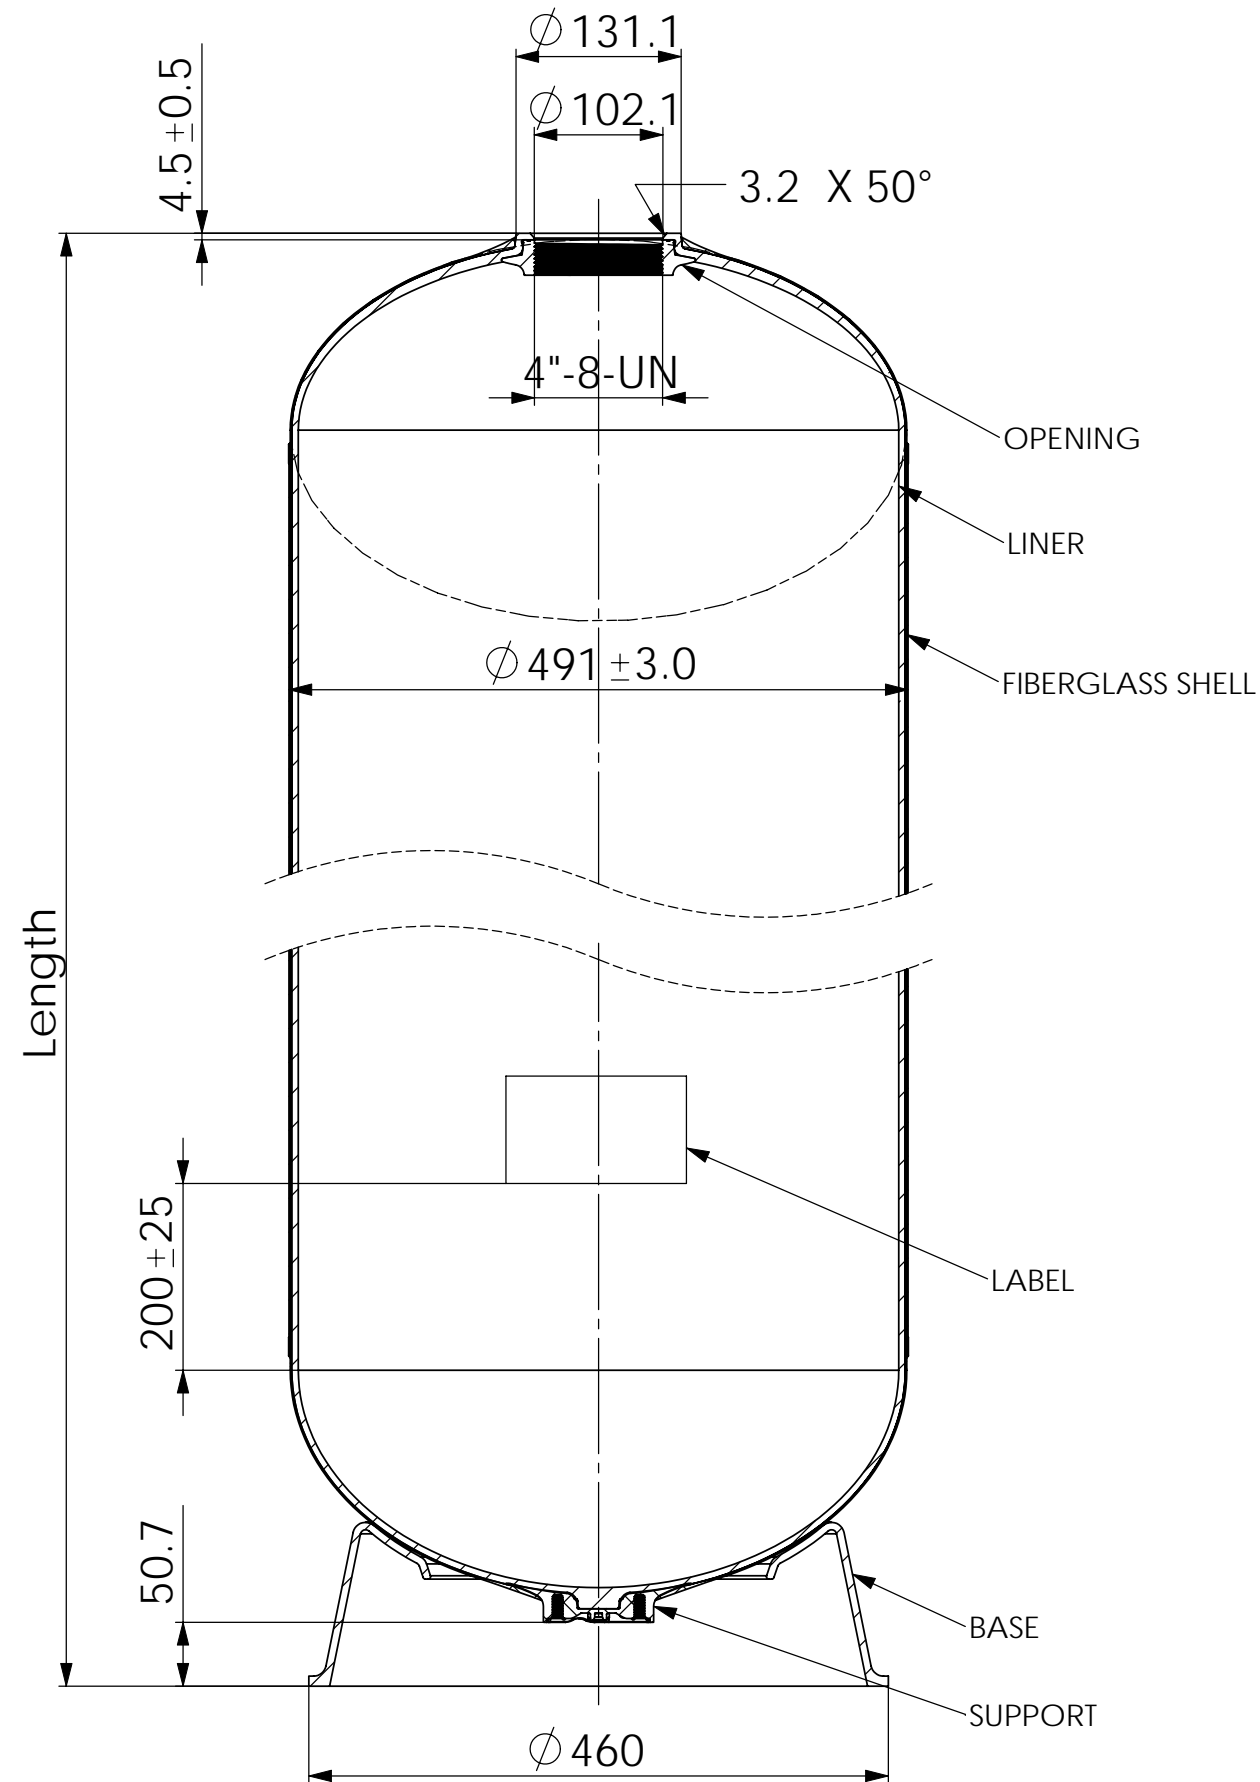


MODEL	Length			VOLUME		WEIGHT	
	mm	inch	+/-	Liters	CU.Ft	Kg	LBS
18x36	1000	39.4	4	138	4.88	19.4	42.68
18x53	1432	56.4	5	211	7.46	24.8	54.6
18x65	1722	67.8	6	257	9.08	28.1	61.8

NOTES:

1. TANK MUST MEET ALL APPLICABLE SPECIFICATIONS OF NSF/ANSI 044 STANDARD, LATEST REVISION.
2. OPERATING SPECIFICATIONS:
 - A. MAXIMUM WORKING PRESSURE - 150PSI (10.5BAR)
 - B. TEMPERATURE RANGE - 34-122 °F (1-50 °C)
 - C. MAXIMUM VACUUM - 5.5"Hg (140mm Hg)
 - D. MEDIA - WATER
3. TEST REQUIREMENT
 - A. BURST PRESSURE TEST: 4.2MPa
 - B. CYCLIC PRESSURE TEST: 1.05MPa / 100,000 CYCLES
 - C. HYDROSTATIC PRESSURE TEST: 2.52MPa / KEEP 15MINs
4. VISUAL LINER INSPECTION
 - A. NO MORE THAN 10 INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS.
 - B. NO INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS LARGER THAN 3 x 3mm
 - C. NO INTERNAL BLEMISHES OR BURNT DEBRIS ALLOWED
5. ALL GLASS STRANDS FROM FIBERGLASS LINER TO BE BONDED AND COVERED
6. LABEL'S POSITION CAN BE CHANGED WITH THE CUSTOMER'S REQUIREMENT

						開能 CANATURE GROUP <i>Canature</i>	
						18" FRP PRESSURE VESSEL (4"-8-UN Opening)	
VERSION NO.	DESCRIPTION OF CHANGES:				SIGNATURE	DATE	
DESIGNER		STANDARD	STAGE	REMARK	NUMBER /SET	SCALE	/
						1:6	MATERIAL:
INSPECTION		AUTHORIZATION	PROJECTION			SOURCING FROM:	
TECHNOLOGIST			TOTAL PAGES:	PAGE NO.		FRP-PV.18-4".00	

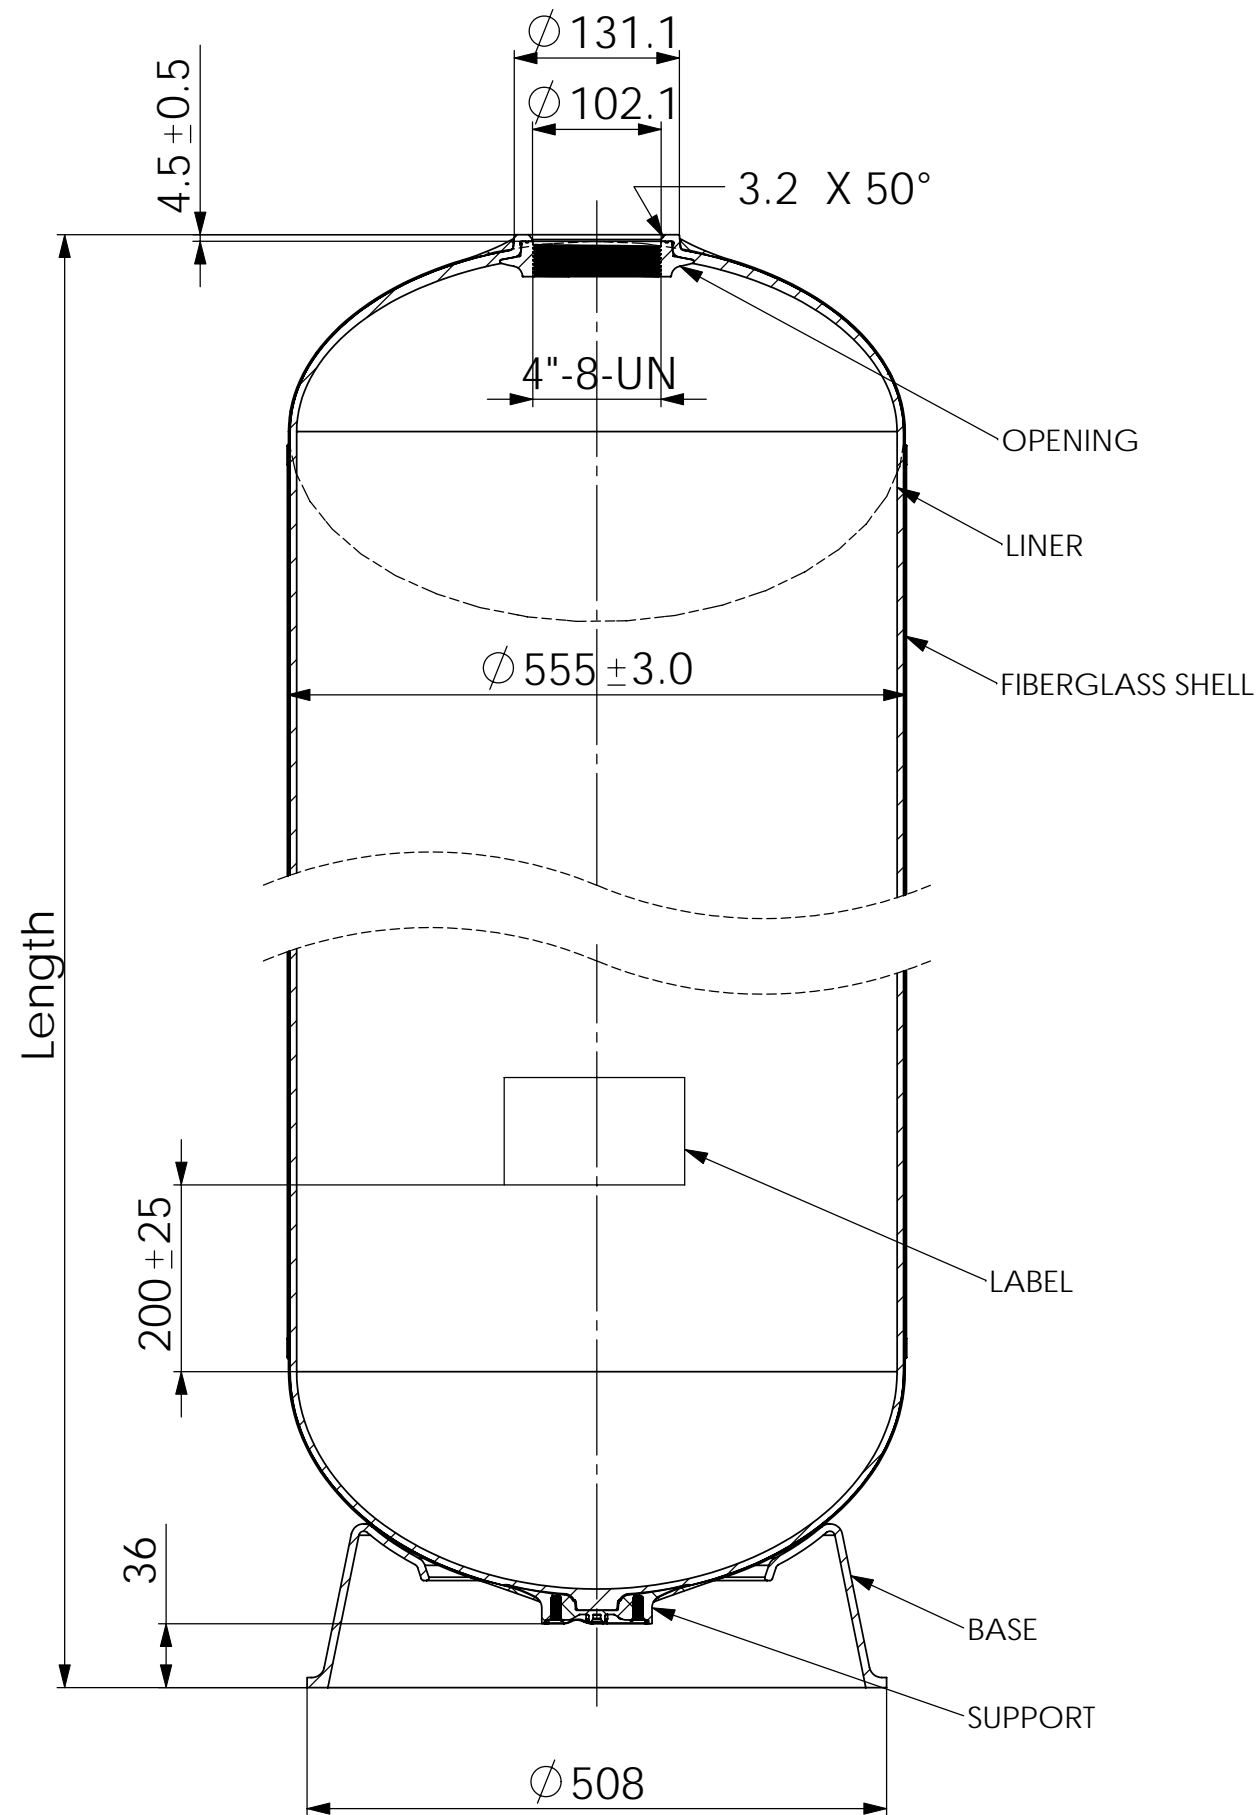


MODEL	Length			VOLUME		WEIGHT	
	mm	inch	+/-	Liters	CU.Ft	Kg	LBS
21×36	1002	39.4	15	164	5.8	23.5	51.7
21×53	1434	56.5	15	253	8.94	30.1	66.2
21×62	1721	67.8	15	330	11.7	32.8	72.2

NOTES:

- TANK MUST MEET ALL APPLICABLE SPECIFICATIONS OF NSF/ANSI 044 STANDARD, LATEST REVISION.
- OPERATING SPECIFICATIONS:
 - MAXIMUM WORKING PRESSURE - 150PSI (10.5BAR)
 - TEMPERATURE RANGE - 34-122 °F (1-50 °C)
 - MAXIMUM VACUUM - 5.5"Hg (140mm Hg)
 - MEDIA - WATER
- TEST REQUIREMENT
 - BURST PRESSURE TEST: 4.2MPa
 - CYCLIC PRESSURE TEST: 1.05MPa / 100,000 CYCLES
 - HYDROSTATIC PRESSURE TEST: 2.52MPa / KEEP 15MINs
- VISUAL LINER INSPECTION
 - NO MORE THAN 10 INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS.
 - NO INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS LARGER THAN 3 x 3mm
 - NO INTERNAL BLEMISHES OR BURNT DEBRIS ALLOWED
- ALL GLASS STRANDS FROM FIBERGLASS LINER TO BE BONDED AND COVERED
- LABEL'S POSITION CAN BE CHANGED WITH THE CUSTOMER'S REQUIREMENT

						開能 CANATURE GROUP <i>Canature</i>	
						21" FRP PRESSURE VESSEL (4"-8-UN Opening)	
VERSION NO.	DESCRIPTION OF CHANGES:				SIGNATURE	DATE	
DESIGNER		STANDARD	STAGE	REMARK	NUMBER /SET	SCALE	/
						1:6	MATERIAL:
INSPECTION		AUTHORIZATION	PROJECTION				SOURCING FROM:
TECHNOLOGIST			TOTAL PAGES:	PAGE NO.	FRP-PV.21-4".00		

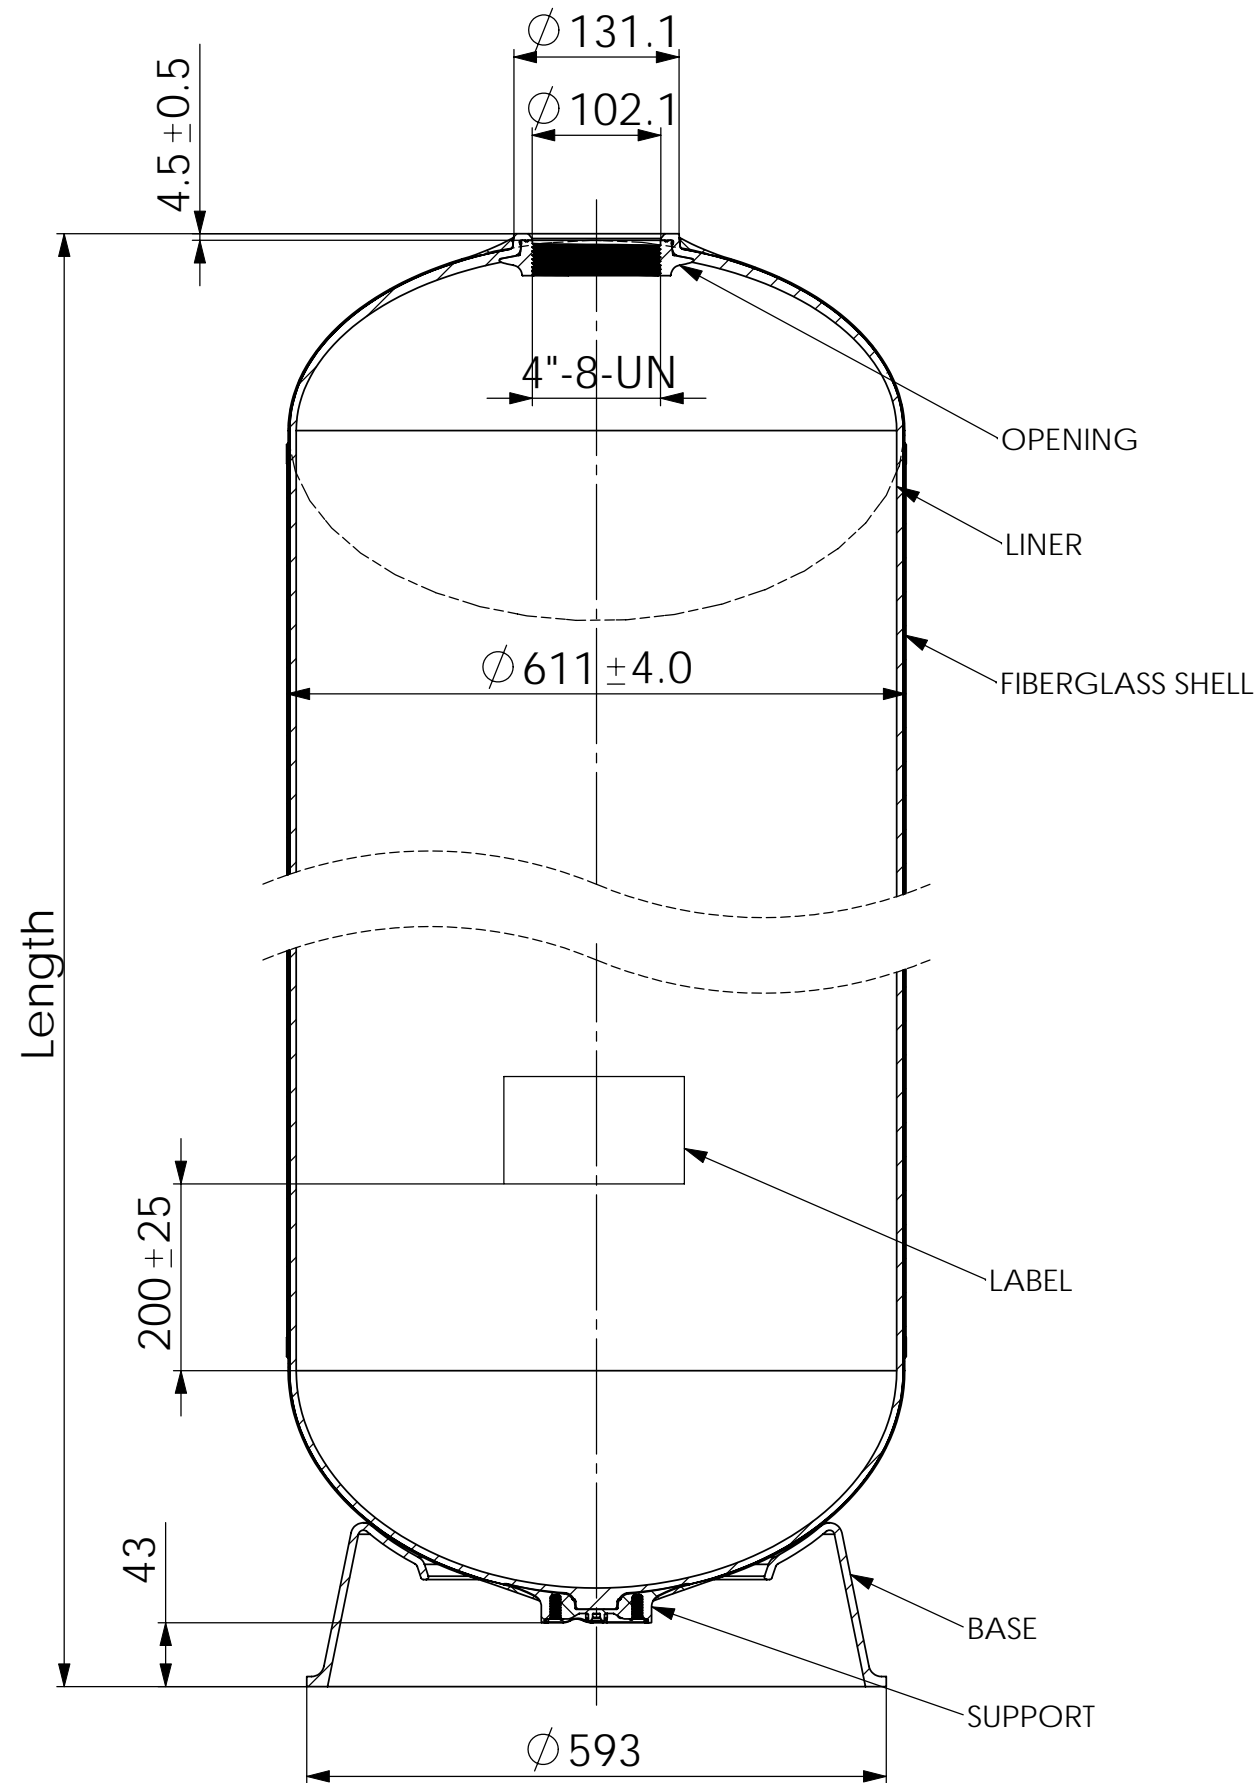

MODEL	Length			VOLUME		WEIGHT	
	mm	inch	+/-	Liters	CU.Ft	Kg	LBS
24x72	1918	75.5	15	494	17.5	44.1	97.02

NOTES:

1. TANK MUST MEET ALL APPLICABLE SPECIFICATIONS OF NSF/ANSI 044 STANDARD, LATEST REVISION.
2. OPERATING SPECIFICATIONS:
 - A. MAXIMUM WORKING PRESSURE - 150PSI (10.5BAR)
 - B. TEMPERATURE RANGE - 34-122 °F (1-50 °C)
 - C. MAXIMUM VACUUM - 5.5"Hg (140mm Hg)
 - D. MEDIA - WATER
3. TEST REQUIREMENT
 - A. BURST PRESSURE TEST: 4.2MPa
 - B. CYCLIC PRESSURE TEST: 1.05MPa / 100,000 CYCLES
 - C. HYDROSTATIC PRESSURE TEST: 2.52MPa / KEEP 15MINS
4. VISUAL LINER INSPECTION
 - A. NO MORE THAN 10 INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS.
 - B. NO INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS LARGER THAN 3 x 3mm
 - C. NO INTERNAL BLEMISHES OR BURNT DEBRIS ALLOWED
5. ALL GLASS STRANDS FROM FIBERGLASS LINER TO BE BONDED AND COVERED
6. LABEL'S POSITION CAN BE CHANGED WITH THE CUSTOMER'S REQUIREMENT

						開能 CANATURE GROUP <i>Canature</i>	
						24" FRP PRESSURE VESSEL (4"-8-UN Opening)	
VERSION NO.	DESCRIPTION OF CHANGES:				SIGNATURE	DATE	
DESIGNER		STANDARD	STAGE	REMARK	NUMBER /SET	SCALE	/
						1:6	MATERIAL:
INSPECTION		AUTHORIZATION	PROJECTION			SOURCING FROM:	
TECHNOLOGIST				TOTAL PAGES:	PAGE NO.	FRP-PV.24-4".00	